



# Manual

## DATAEAGLE 3000 Series – Wireless PROFIBUS

Schildknecht AG

26. Januar 2023



Provided and tech-supported in the U.S. by  
Aunex Inc.  
725 Prudden Street  
Lansing, MI 48906  
phone 863 303 8038  
support@aunex.io

Schildknecht AG  
Haugweg 26  
D-71711 Murr  
Tel.: +49 (7144) 89718 0  
Mail: [info@schildknecht.ag](mailto:info@schildknecht.ag)





This document applies to the following products:

| <b>Name</b>                          | <b>Article number</b> |
|--------------------------------------|-----------------------|
| DATAEAGLE Compact 3715A Master/Slave | 11160 / 11161         |
| DATAEAGLE X-treme 3715A Master/Slave | 11320 / 11321         |
| DATAEAGLE Compact 3713A Master/Slave | 11164 / 11165         |
| DATAEAGLE X-treme 3713A Master/Slave | 11324 / 11325         |
| DATAEAGLE Compact 3712A Master/Slave | 11168 / 11169         |
| DATAEAGLE X-treme 3712A Master/Slave | 11326 / 11327         |
| DATAEAGLE Compact 3333A Master/Slave | 11183 / 11184         |
| DATAEAGLE X-treme 3333A Master/Slave | 11370 / 11371         |
| DATAEAGLE Compact 3343A Master/Slave | 11148 / 11149         |
| DATAEAGLE X-treme 3343A Master/Slave | 11330 / 11331         |
| DATAEAGLE Compact 373xA              | 15375                 |
| DATAEAGLE X-treme 373xA              | 15376                 |

|          |                 |
|----------|-----------------|
| Version  | 1.0             |
| Language | EN              |
| Date     | 26. Januar 2023 |

Schildknecht AG

Haugweg 26  
D-71711 Murr  
Tel.: +49 (7144) 89718 0  
Mail: [info@schildknecht.ag](mailto:info@schildknecht.ag)



# Table of contents

|          |                                                                |           |
|----------|----------------------------------------------------------------|-----------|
| <b>1</b> | <b>Introduction</b>                                            | <b>6</b>  |
| 1.1      | Service and Support . . . . .                                  | 6         |
| 1.2      | About this document . . . . .                                  | 6         |
| 1.3      | Trademark . . . . .                                            | 7         |
| <b>2</b> | <b>For your safety</b>                                         | <b>8</b>  |
| 2.1      | General safety instructions . . . . .                          | 8         |
| 2.2      | Intended use . . . . .                                         | 9         |
| 2.3      | Environmentally friendly disposal . . . . .                    | 10        |
| 2.4      | CE Declaration of Conformity . . . . .                         | 11        |
| 2.5      | Warranty and liability claims . . . . .                        | 11        |
| <b>3</b> | <b>Description</b>                                             | <b>12</b> |
| 3.1      | Introduction . . . . .                                         | 12        |
| 3.2      | Operating principle DATAEAGLE 3000 . . . . .                   | 12        |
| 3.3      | DATAEAGLE Compact . . . . .                                    | 13        |
| 3.3.1    | Connections . . . . .                                          | 13        |
| 3.3.2    | LEDs . . . . .                                                 | 14        |
| 3.4      | DATAEAGLE X-treme . . . . .                                    | 15        |
| 3.4.1    | Connections . . . . .                                          | 15        |
| 3.4.2    | LEDs . . . . .                                                 | 16        |
| <b>4</b> | <b>Mounting</b>                                                | <b>18</b> |
| 4.1      | Requirements . . . . .                                         | 18        |
| 4.2      | Dimensions . . . . .                                           | 19        |
| 4.3      | Mounting the components . . . . .                              | 20        |
| 4.4      | Mounting the antennas . . . . .                                | 22        |
| 4.5      | Disassembly and module replacement . . . . .                   | 23        |
| <b>5</b> | <b>Installation</b>                                            | <b>24</b> |
| 5.1      | Power supply connection . . . . .                              | 24        |
| 5.2      | PROFIBUS connection . . . . .                                  | 26        |
| <b>6</b> | <b>Commissioning</b>                                           | <b>28</b> |
| 6.1      | Delivery state of the modules . . . . .                        | 28        |
| 6.2      | Configuration Filtertime . . . . .                             | 29        |
| 6.3      | Configuration radio parameters . . . . .                       | 31        |
| 6.3.1    | 2,4 GHz Bluetooth - DATAEAGLE Compact/X-treme 371x . . . . .   | 33        |
| 6.3.2    | 2,4 GHz Bluetooth 5 - DATAEAGLE Compact/X-treme 373x . . . . . | 34        |
| 6.3.3    | 869 MHz - DATAEAGLE Compact/X-treme 333x . . . . .             | 35        |
| 6.3.4    | 915 MHz - DATAEAGLE Compact/Xtreme 334x . . . . .              | 37        |
| 6.4      | Diagnosis . . . . .                                            | 39        |
| 6.4.1    | Integrated PROFIBUS DP diagnostic slave . . . . .              | 39        |
| 6.4.2    | Diagnostic via terminal mode . . . . .                         | 47        |



|          |                                                                                  |           |
|----------|----------------------------------------------------------------------------------|-----------|
| <b>7</b> | <b>Tips and tricks</b>                                                           | <b>48</b> |
| 7.1      | Improvement of EMC resistance . . . . .                                          | 48        |
| 7.1.1    | Introduction . . . . .                                                           | 48        |
| 7.1.2    | Basic rules . . . . .                                                            | 48        |
| 7.2      | Optimal antenna mounting . . . . .                                               | 50        |
| <b>8</b> | <b>Technical data</b>                                                            | <b>51</b> |
| 8.1      | DATAEAGLE Compact 3715A Master/Slave - Article number: 11160 / 11161 . . . . .   | 52        |
| 8.2      | DATAEAGLE X-treme 3715A Master/Slave - Article number: 11320 / 11321 . . . . .   | 53        |
| 8.3      | DATAEAGLE Compact 3713A Master/Slave - Article number: 11164 / 11165 . . . . .   | 54        |
| 8.4      | DATAEAGLE X-treme 3713A Master/Slave - Article number: 11324 / 11325 . . . . .   | 55        |
| 8.5      | DATAEAGLE Compact 3712A Master/Slave - Article number: 11168 / 11169 . . . . .   | 56        |
| 8.6      | DATAEAGLE X-treme 3712A Master/Slave - Article number: 11326 / 11327 . . . . .   | 57        |
| 8.7      | DATAEAGLE Compact 3333A Master/Slave - Article number: 11142 / 11143 . . . . .   | 58        |
| 8.8      | DATAEAGLE X-treme 3333A Master/Slave - Article number: 11370 / 11371 . . . . .   | 59        |
| 8.9      | DATAEAGLE Compact 3343A Master/Slave - Article number: 11148 / 11149 . . . . .   | 60        |
| 8.10     | DATAEAGLE X-treme 3343A Master/Slave - Article number: 11330 / 11331 . . . . .   | 61        |
| 8.11     | DATAEAGLE Compact 373xA - Article number: 15375 . . . . .                        | 62        |
| 8.11.1   | Software Feature PROFIBUS Point-to-Point - Article number: 15380 . . . . .       | 63        |
| 8.11.2   | Software Feature PROFIBUS Multipoint - Article number: 15381 . . . . .           | 63        |
| 8.11.3   | Software Feature PROFIBUS PROFIsafe Multipoint - Article number: 15382 . . . . . | 63        |
| 8.12     | DATAEAGLE X-treme 373xA - Article number: 15376 . . . . .                        | 64        |
| 8.12.1   | Software Feature PROFIBUS Point-to-Point - Article number: 15380 . . . . .       | 65        |
| 8.12.2   | Software Feature PROFIBUS Multipoint - Article number: 15381 . . . . .           | 65        |
| 8.12.3   | Software Feature PROFIBUS PROFIsafe Multipoint - Article number: 15382 . . . . . | 65        |
| <b>9</b> | <b>Legal notice</b>                                                              | <b>66</b> |



# 1 Introduction

## 1.1 Service and Support

The members of our service team are at your disposal for all questions regarding installation and commissioning.

Call us at +49 (7144) 89718 0 or send an  
E-mail to: [info@schildknecht.ag](mailto:info@schildknecht.ag)

You can also find more information and documentation on our website:  
<https://www.schildknecht.ag>

## 1.2 About this document

This document contains information on

- Assembly and electrical installation
- Commissioning and parameterization
- Fault diagnosis and troubleshooting
- Conformity and approval

### Please note

- Read this chapter carefully, only then work with the documentation and the device.
- Read the documentation carefully before commissioning the device.
- Keep the document for the entire service life of the device in a place that is accessible to all users at all times.

General knowledge of automation technology is required to understand the document. In addition, the planning and use of automation systems requires technical expertise that is not provided in this document.

### Function of this documents

This document instructs the technical personnel of the machine manufacturer or the machine operator on the safe use of the described devices. It instructs **not** on the safe use of the machine in which the devices are or will be integrated. Information on this can be found in the operating instructions for the machine.



### 1.3 Trademark

In this documentation the trademarks of the following companies and institutions are used:

**PROFIBUS** PROFIBUS Nutzerorganisation e.V. (PNO)

**PROFIsafe** PROFIBUS Nutzerorganisation e.V. (PNO)



## 2 For your safety

- Read this chapter carefully.
- Only then work with the DATAEAGLE module.

### 2.1 General safety instructions

#### ATTENTION!

##### **High electrical voltage in the machine / plant.**

Death or serious injury due to electric shock.

- When working on the machine / modules, observe the five safety rules of electrical engineering.

##### **Protection of persons and property**

- According to DIN VDE 0105-100 - Operation of electrical installations - Part 100: General requirements

##### **The five safety rules**

###### ***Protect from high electrical voltage***

1. unlocking
2. securing against reconnection
3. establishing absence of voltage on all poles
4. grounding and short-circuiting
5. covering or isolating adjacent live parts

##### **Qualified personnel**

The module may only be installed, commissioned and operated by qualified personnel who have been instructed in safety technology.

You are knowledgeable if you meet the following conditions:

- have a suitable electrotechnical training.
- have been instructed by the machine operator in the operation of the equipment and the valid safety regulations
- have access to the operating instructions and the manual
- are familiar with the safety standards of automation technology
- are familiar with the basic and technical standards applicable to the specific application

##### **Use of the module**

- Observe all regulations on safety and accident prevention during project planning, installation, commissioning, operation and testing of the module.
- When using aggressive medium, check the material resistance.



---

**NOTE:** Only qualified Schildknecht AG personnel may intervene in the hardware and software.

---

### **WARNING!**

#### **High electrical voltages!**

Death or serious injury due to electric shock. Due to a defect of the power supply unit, voltages higher than 120 V DC or 50 V AC may be applied to touchable parts.

- Only use a power supply that allows max. 60 V DC or 25 V AC in the event of a fault. It must conform to SELV or PELV.
- The power supply must be SELV and LPS compliant according to UL/IEC 60950-1 or ES1 and PS2 compliant according to UL/IEC 62368-1.

#### **Protective measures of the operator of the machine**

- Observe the instructions in this manual.
- Observe the test specifications in the operating instructions of all connected components.

**Electromagnetic radiation** Keep a minimum distance of 20 cm from the antennas while operating the equipment.

## **2.2 Intended use**

The DATAEAGLE transmits data in industrial applications. It is designed according to EN 60529 for protection class IP20 (Compact) or IP65 (X-treme) and can be used in control cabinets up to protection class IP67.

The DATAEAGLE may only be used for the cases provided for in the operating instructions and manual and only in conjunction with the third-party devices and components recommended or approved by Schildknecht AG.

Correct and safe operation of the product requires proper transport, storage, assembly and installation, as well as careful operation.

Intended use also includes EMC-compliant electrical installation. The module is intended for use in an industrial environment. Radio interference may occur when used in residential areas.

- When using the module in residential and mixed areas, observe the applicable standards.

### Foreseeable misuse

- Do not modify the module structurally, technically or electrically.
- Do **not** use the module outside the areas described in this manual, the technical data and the operating instructions.
- Do **not** use the module as a safety-related device. It does not comply with the relevant standards. Safety functions of the system are not guaranteed!
- Do **not** use the off-state of the outputs of the module for safety-related requirements of the plant/machine!
- Do **not** use the module for permanent operation in liquids.
- Do **not** clean the module with a high-pressure cleaner.

## 2.3 Environmentally friendly disposal

### Observe country-specific waste disposal regulations!

- Always dispose of unusable devices in accordance with the applicable country-specific regulations for waste disposal (e.g. according to European waste code 16 02 14).

### Material separation only by qualified personnel!

- Be careful when disassembling the device, you may injure yourself.
- Take the separated components to the appropriate recycling.

### Disposal

The product can be returned to Schildknecht AG in case of disposal. This also applies to the original packaging and any batteries or rechargeable batteries. Devices contaminated with hazardous substances will not be taken back for repair or disposal.





## Return

- Mark the product and packaging with '**For disposal**'.
- Pack the product
- Send the package to:  
**Schildknecht AG**  
**Haugweg 26**  
**71711 Murr | GERMANY**

We ensure disposal in accordance with German statutory regulations. The last owner is responsible for the transport to the return point up to the destination.

## 2.4 CE Declaration of Conformity

For information on the Declaration of Conformity and EC Directives, see:  
<https://www.schildknecht.ag/download/dataeagle-konformitaetserklaerung/>

Alternatively, on our website <https://www.schildknecht.ag> in the Downloads section.

## 2.5 Warranty and liability claims

Warranty and liability claims are lost if

- the product is not used as intended,
- damage is due to failure to observe the operating instructions,
- the staff was/is not knowledgeable.

## 3 Description

### 3.1 Introduction

The modules of the DATAEAGLE 3000 series have been specially developed for the transparent transmission of PROFIBUS via radio.

Different radio technologies, such as Bluetooth 2.4 GHz or 869 / 915 MHz in the unlicensed band, are used for transmission. PROFIBUS speeds of up to 1.5 Mbit/s can be configured using integrated data preprocessing.

In addition, the wireless systems are easy to connect and put into operation like a cable - plug & play.

There are 2 different housing variants Compact (IP 20) for control cabinet mounting and X-treme (IP65) for use in direct industrial environments or outdoors.

Our software DATAEAGLE Wizard allows a quick set-up of the essential settings, such as radio parameters. The commissioning is therefore done in a very short time.

### 3.2 Operating principle DATAEAGLE 3000

The DATAEAGLE 3000 is suitable for the transparent transmission of PROFIBUS data via radio.

Point-to-point as well as multipoint systems can be configured.




Radio interference can be suppressed via the filter time that can be configured in the master. Only after this time has elapsed do the PROFIBUS stations detect a bus fault. All interruptions of the communication within the filter time are suppressed and the plant availability is thus increased.

A too high configured filter time (factory setting: 2 seconds), can lead to a delayed shutdown reaction of the connected devices in case of an error. Therefore, please check whether the system with the set filter time matches the required reaction speed.

## 3.3 DATAEAGLE Compact

### 3.3.1 Connections

#### Power supply



| Clamps | Description      |
|--------|------------------|
| 24V    | 24 V DC          |
| GND    | 0V               |
| PE     | PE               |
| REL    | Switching output |

#### USB port

DATAEAGLE Compact has a USB port for configuration and software updates via the DATAEAGLE Wizard tool.

#### Antenna connection



SMA connector for antenna

#### PROFIBUS Interface




9 pin SUB-D connector for PROFIBUS

#### Pin assignment

| PIN | Description    |
|-----|----------------|
| 1   | do not connect |
| 2   | do not connect |
| 3   | B/TX+/Rx+      |
| 4   | do not connect |
| 5   | GND2           |
| 6   | VCC2 (5V)      |
| 7   | do not connect |
| 8   | A/TX-/RX-      |
| 9   | do not connect |

### 3.3.2 LEDs



#### ON LED

| LED | Indication | State           | Description  |
|-----|------------|-----------------|--------------|
| ON  | Green      | Permanently lit | Power ok     |
|     | Off        | Off             | Power not ok |

#### RX LED

| LED | Indication | State    | Description        |
|-----|------------|----------|--------------------|
| RX  | Yellow     | Flashing | Radio reception    |
|     | Off        | Off      | No radio reception |

#### LINK LED

| LED  | Indication | State       | Description                  |
|------|------------|-------------|------------------------------|
| LINK | Blue       | On/Blinking | Radio connection(s) active   |
|      | Off        | Off         | Radio Connection(s) inactive |

#### BF LED


| LED | Anzeige | Zustand           | Beschreibung                                |
|-----|---------|-------------------|---------------------------------------------|
| BF  | Red     | On (Master)       | no PROFIBUS connection                      |
|     | Red     | Blinking (Master) | PROFIBUS connection Searching for DP Slaves |
|     | Off     | Off               | no Error                                    |

## 3.4 DATAEAGLE X-treme

### 3.4.1 Connections

#### Power supply


M12, A-coded, 5 pin (male)



| PIN | Description   |
|-----|---------------|
| 1   | +24 VDC       |
| 2   | not connected |
| 3   | GND           |
| 4   | not connected |
| 5   | PE            |

#### PROFIBUS Interface

M12, B-coded, 5 pin (male), 5 pin (female)

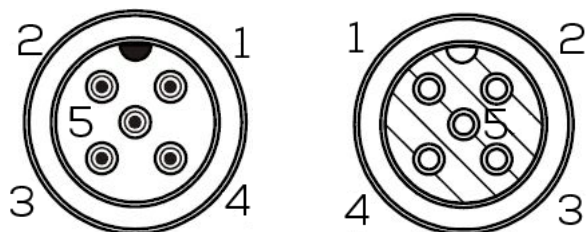


| PIN | Description   |
|-----|---------------|
| 1   | VCC           |
| 2   | A             |
| 3   | GND           |
| 4   | B             |
| 5   | not connected |

### USB port


The DATAEAGLE X-treme has a USB port for configuration and software updates via the DATAEAGLE Wizard tool. This is located behind the PG screw.

### Antenna connection



SMA connector for antenna

### 3.4.2 LEDs



#### ON LED

| LED | Indication | State           | Description  |
|-----|------------|-----------------|--------------|
| ON  | Green      | Permanently lit | Power ok     |
|     | Off        | Off             | Power not ok |

#### RX LED

| LED | Indication | State    | Description        |
|-----|------------|----------|--------------------|
| RX  | Yellow     | Flashing | Radio reception    |
|     | Off        | Off      | No radio reception |

#### LINK LED

| LED  | Indication | State       | Description                  |
|------|------------|-------------|------------------------------|
| LINK | Blue       | On/Blinking | Radio connection(s) active   |
|      | Off        | Off         | Radio Connection(s) inactive |



## STAT LED

| LED | Anzeige | Zustand           | Beschreibung                                |
|-----|---------|-------------------|---------------------------------------------|
| BF  | Red     | On (Master)       | no PROFIBUS connection                      |
|     | Red     | Blinking (Master) | PROFIBUS connection Searching for DP Slaves |
|     | Off     | Off               | no Error                                    |



## 4 Mounting


### 4.1 Requirements

- Mounting site in the immediate vicinity of the plant
- Flat mounting surface for mechanically stress-free mounting
- Grounded mounting surface for grounding of the ground strap
- Short cable routes to all components
- Sufficient space for easy device replacement and for the connection of the plug-in connectors
- Suitable mounting location with regard to vibration and shock load, temperature and humidity (see "4. Technical data" )
- Protected to prevent disconnection of the connecting cables by personnel or equipment.
- Diagnostic LEDs of the device can be viewed during operation

## 4.2 Dimensions


### DATAEAGLE Compact

Dimensions in mm

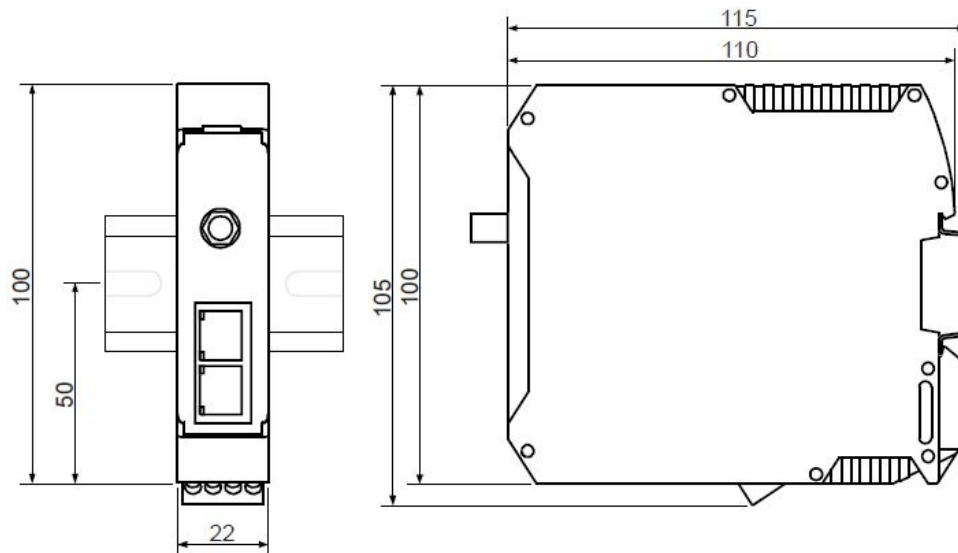


### DATAEAGLE X-treme

Dimensions in mm

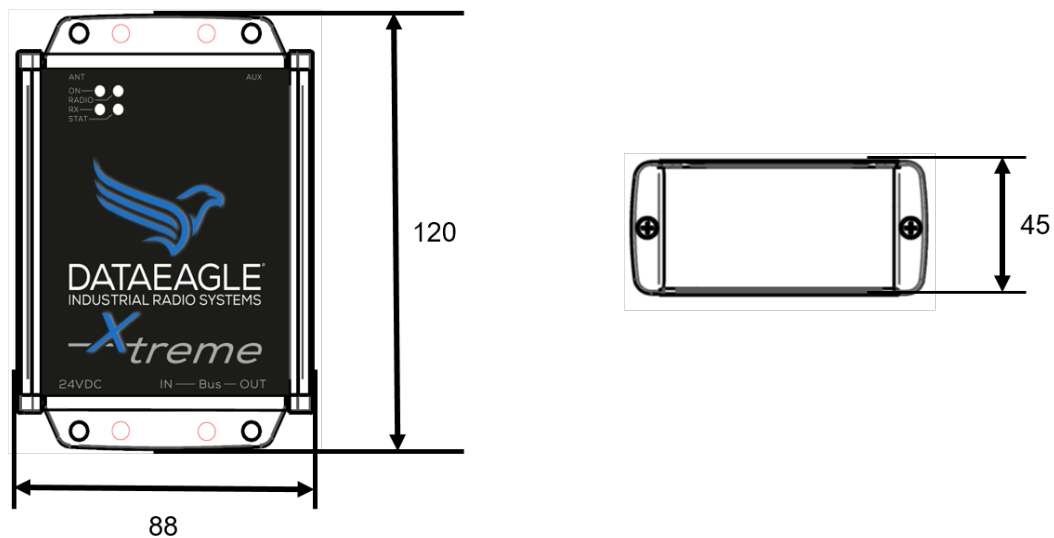

### 4.3 Mounting the components

#### DATAEAGLE Compact

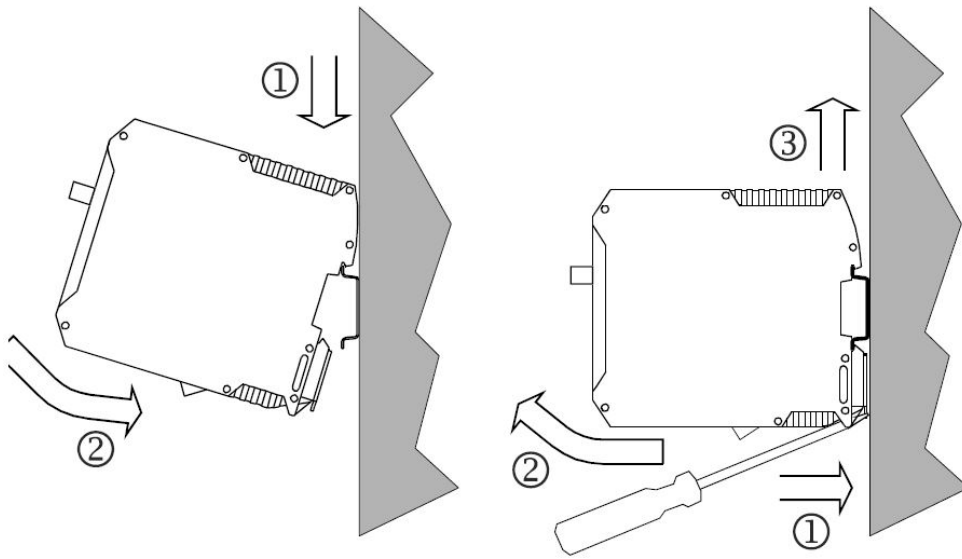

→ Fasten the module at the designated place according to its fastening type.

**Mount:**

1. Place the module from diagonally above onto the top-hat rail.


2. Press the module down firmly.

*The foot latch engages. The unit is firmly seated on the top-hat rail.*

Example:



## DATAEAGLE X-treme

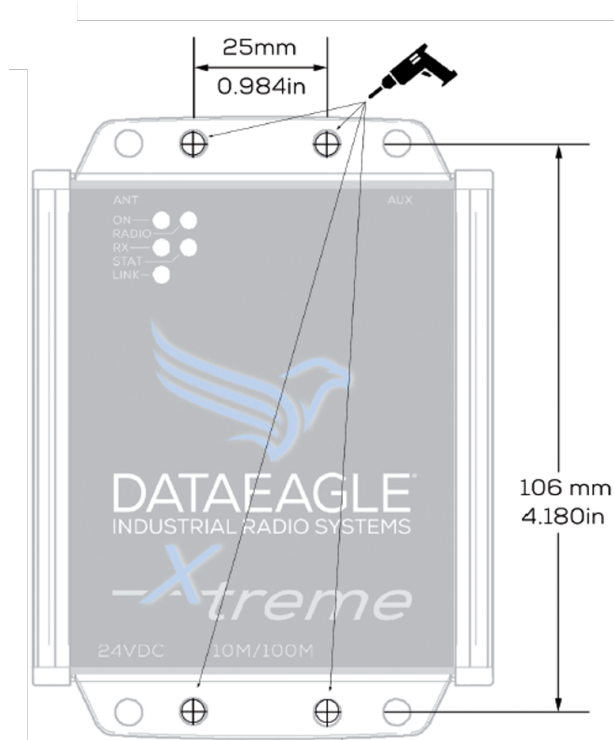

→ Attach the module to the designated location according to its mounting method.


### **Mount:**

1. If necessary, drill holes for mounting according to the enclosed drilling template →

<https://www.schildknecht.ag/download/x-treme-drill-template-bohrschablone/>.

2. Screw the device tightly.

## 4.4 Mounting the antennas

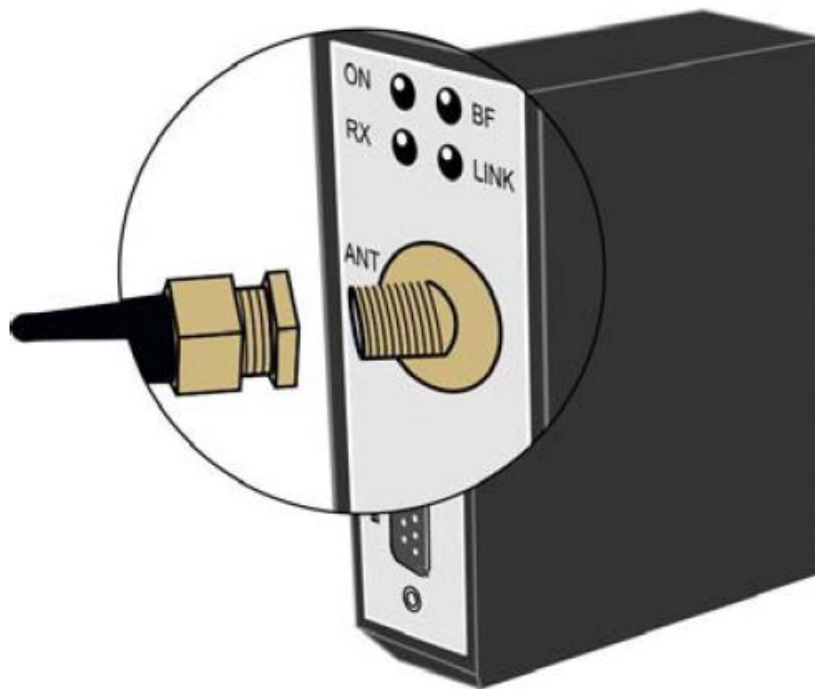

1. Connect the SMA connectors of the antennas or antenna cables.
2. Attach the antennas to the designated locations.

### ATTENTION!

Tighten the screw connections of the antennas or antenna cables only hand-tight.

### FURTHER NOTES ON ANTENNA INSTALLATION!

You will find further information on antenna mounting and alignment in our Antenna 101 → <https://lp.schildknecht.ag/en/whitepaper-antenna101>



## 4.5 Disassembly and module replacement

### Remove line connections

1. Remove the power supply.
2. Unscrew the antenna cable/antenna.

### Remove module (See assembly of the module)

### Mount new module (See assembly of the module)

1. Mount the new module.
2. Connect the wires to the new module (See Connection power supply).

## 5 Installation

### **WARNING!**

**Danger to life due to electric shock.**

Operation of the device only intended on 24V DC voltage (safety extra-low voltage)

Death and serious injuries as well as considerable property damage can be the result.

- Connection of the device may only be carried out by an electrician in accordance with IEC 60364!
- Do not connect this equipment directly to other networks!
- Observe five safety rules! See chapter 2.1

### **CAUTION!**

**Electromagnetic interference!**

Uncontrolled processes and damage due to disturbed data transmission!

- Observe the chapter **Improving EMC resistance 7.1 during all installation steps.**

### **NOTE**

Connected cables must be approved for 60°C.

## 5.1 Power supply connection

### **WARNING!**

**Fire hazard due to short circuit!**

Supply lines and/or modules damaged by short circuits can overheat and cause fires!

- Provide intelligent current monitoring and fuse. The fuse protection must be designed for max. 2A.

### **ATTENTION!**


**Electromagnetic interference due to incorrect voltage supply!**

Electromagnetic interference may occur if rated operating voltages other than 24 V DC of the SELV (safety extra low voltage) category are used.

- Only use power supplies that comply with the SELV category.

→Note technical data


### Power supply - DATAEAGLE Compact



| Clamps | Description      |
|--------|------------------|
| 24V    | 24 V DC          |
| GND    | 0V               |
| PE     | PE               |
| REL    | Switching output |

### Power supply - DATAEAGLE X-treme

M12, A-coded, 5 pin (male)



| PIN | Description   |
|-----|---------------|
| 1   | +24 VDC       |
| 2   | not connected |
| 3   | GND           |
| 4   | not connected |
| 5   | PE            |

## 5.2 PROFIBUS connection

### PROFIBUS - DATAEAGLE Compact



9 pin SUB-D connector for PROFIBUS

#### Pin assignment


| PIN | Description    |
|-----|----------------|
| 1   | do not connect |
| 2   | do not connect |
| 3   | B/TX+/Rx+      |
| 4   | do not connect |
| 5   | GND2           |
| 6   | VCC2 (5V)      |
| 7   | do not connect |
| 8   | A/TX-/RX-      |
| 9   | do not connect |

#### PROFIBUS termination

If DATAEAGLE Compact is the first or last station on the physical PROFIBUS, a terminating resistor must be activated on the PROFIBUS connector of the connection cable.

## PROFIBUS - DATAEAGLE X-treme

M12, B-coded, 5 pin (male), 5 pin (female)

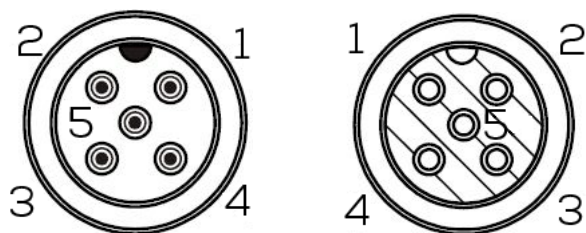

| PIN | Description   |
|-----|---------------|
| 1   | VCC           |
| 2   | A             |
| 3   | GND           |
| 4   | B             |
| 5   | not connected |

## PROFIBUS termination

If the DATAEAGLE X-treme is the first or last station on the physical PROFIBUS, an M12 terminating resistor (e.g. article no.: 11890) must be screwed onto one of the two M12 connections.



## 6 Commissioning

### **WARNING!**

#### **Risk of burns**

Loosening or making electrical connections during operation is prohibited! In case of non-observance, there is a risk of electric arcs which can lead to burns.

→ Disconnect the module from the power supply.

### **CAUTION!**

#### **Uncontrolled processes**

Material damage and personal injury due to incorrectly performed commissioning phases (e.g. initial commissioning, recommissioning and in the event of changes to the configuration).

Always carry out commissioning in this order:

1. insert module
2. have the system checked and approved by a qualified person
3. commission

### **ATTENTION**

#### **Dysfunctions in the living area**

The devices of EMC class A can cause disturbances in the living area.

→ The operator must take appropriate measures.

## 6.1 Delivery state of the modules

### **NOTE**

New devices are preconfigured at the factory.

In the delivery state, the device is in autobauding mode. This means that the DATAEAGLE searches for the correct PROFIBUS baud rate after switching on.


## 6.2 Configuration Filvertime

The following must be available for the device configuration:


- USB driver CDM21228 ([Download Link](#)) - Installed on PC
- Configuration Tool DATAEAGLE Wizard ([Download Link](#)) - Installed on PC
- USB cable - between PC and DATAEAGLE

Connect DATAEAGLE to the PC via the USB cable and start the DATAEAGLE Wizard configuration software.

Select *Autodetect COM Port* and then *Connect* to connect to DATAEAGLE and read the configuration. The DATAEAGLE must be switched on for this.

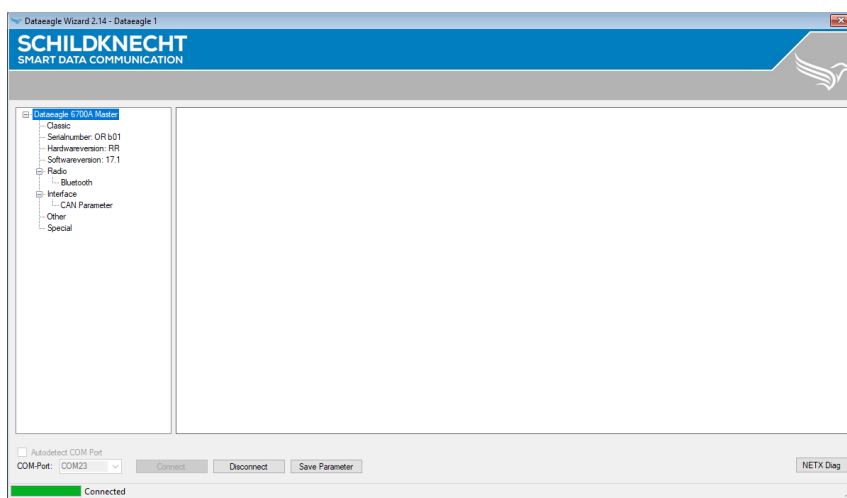

Select in the menu tree: *Interface* → *DP Parameter*

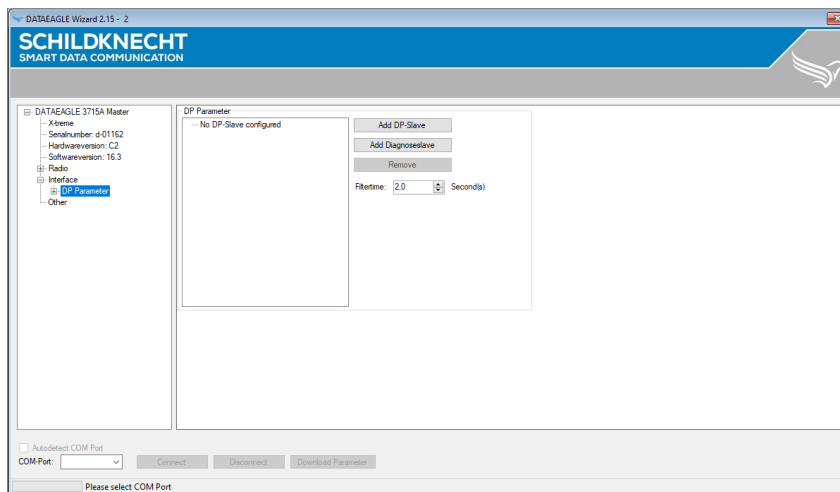

Set the filter time to the desired value.

## NOTE

The filter time is configured to 2 seconds at the factory.

A too high configured filter time can lead to a delayed shutdown reaction of the connected devices in case of an error. Therefore, please check whether the system with the set filter time matches the required reaction speed.


## 6.3 Configuration radio parameters

The following must be available for the device configuration (all components included in the scope of delivery):


- USB driver - installed on PC
- DATAEAGLE Wizard configuration tool - installed on PC
- USB cable - between PC and DATAEAGLE

Connect DATAEAGLE to the PC via the USB cable and start the DATAEAGLE Wizard configuration software.

Select *Connect* to connect to DATAEAGLE and read the configuration. The DATAEAGLE must be switched on for this.

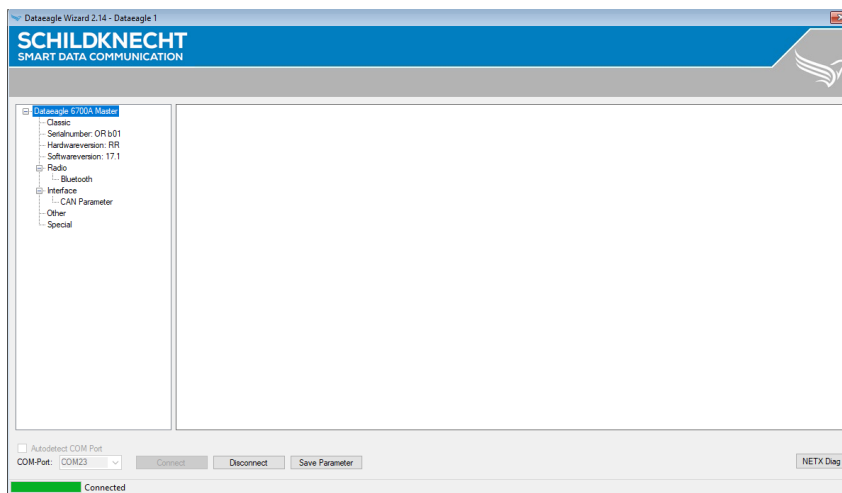

Select in the menu tree: *Interface* → *Radio*

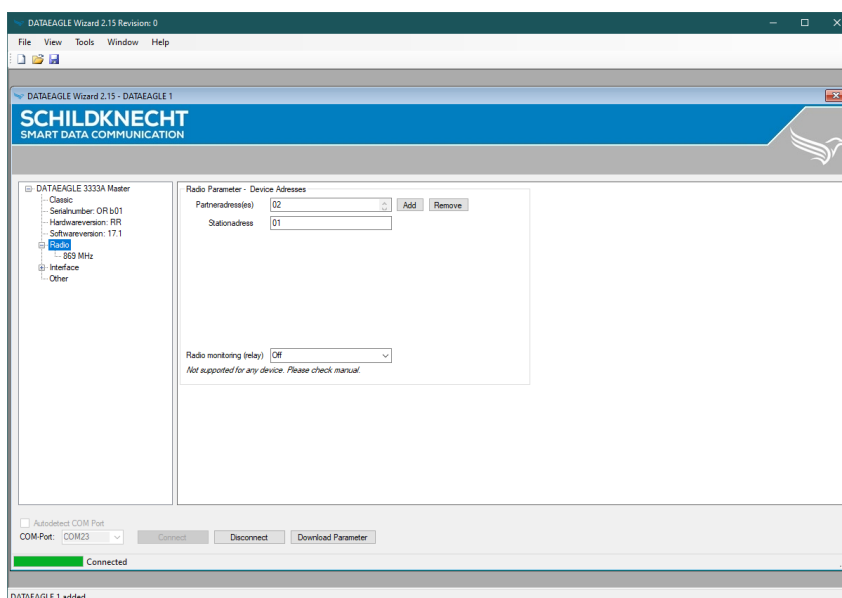



The logical radio device addresses, such as the partner and station address, are set under Radio. These are used independently of the radio technology used for logical addressing within the radio network.

---

**NOTE**

If a radio system was ordered as a set (set configuration), no change is necessary here.

---

Each device has its own logical radio device address (station address) and one or more radio partner addresses in the radio network.

**Example:**


Master has the station address 01 and the partner addresses 02 and 03.

Slave 1 has the station address 02 and the partner address 01.

Slave 2 has the station address 03 and the partner address 01.

### 6.3.1 2,4 GHz Bluetooth - DATAEAGLE Compact/X-treme 371x

Select in the menu tree: *Interface* → *Radio* → *Bluetooth*

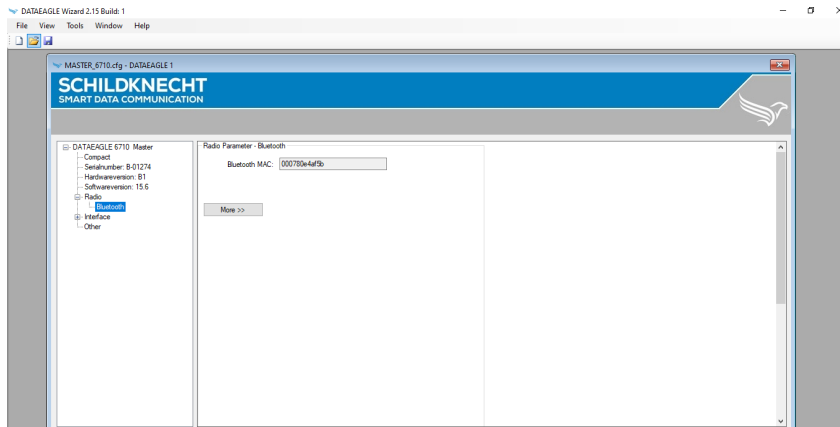


#### NOTE

If a radio system was ordered as a set (set configuration), no change is necessary here.

The Bluetooth MAC address must be read out at the master and entered at the slave.

### 6.3.2 2,4 GHz Bluetooth 5 - DATAEAGLE Compact/X-treme 373x

Select in the menu tree: *Interface* → *Radio* → *Bluetooth LE*

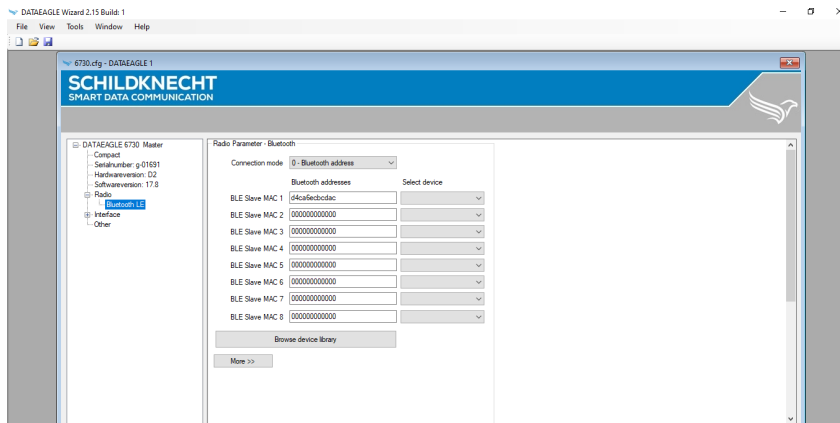

#### NOTE

If a radio system was ordered as a set (set configuration), no change is necessary here.

The Bluetooth MAC address must be read out at the slave and entered at the master.


If a radio network is configured, several Bluetooth MAC addresses must be configured in the master (BLE slave MAC 1, BLE slave MAC 2, ...).

### 6.3.3 869 MHz - DATAEAGLE Compact/X-treme 333x

#### NOTE

If a radio system was ordered as a set (set configuration), no change is necessary here.

Select in the menu tree: *Interface* → *Radio* → *869 MHz*

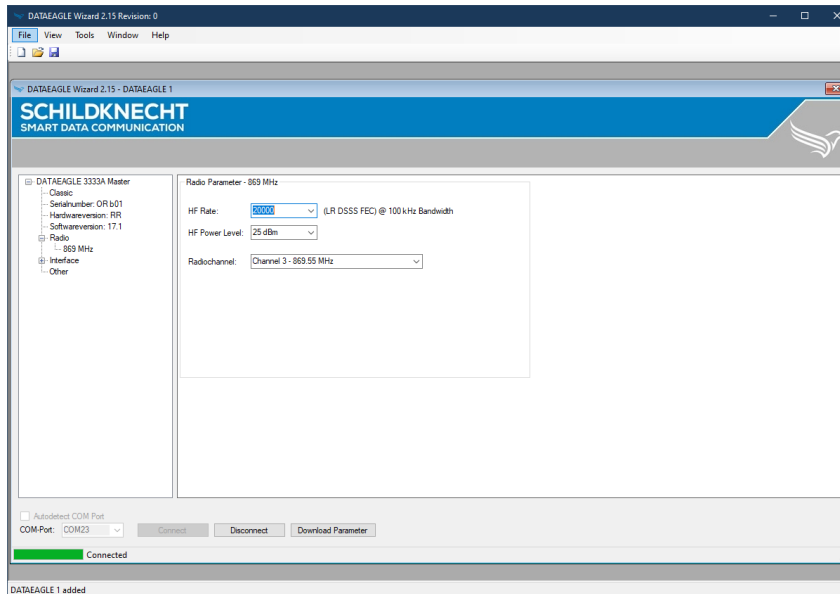

**Configuration parameters 869 MHz**

| Value          | Description               | Comment                                                                                                                                                                                                                                                                           |
|----------------|---------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| HF Rate        | Modulation method         | 20k (LR DSSS FEC) @ 100 kHz<br>Channel 1 or 3 only<br>Highest range, slow<br><br>38.4k (GFSK) @ 100 kHz Bandwidth-<br>Channel 1 or 3 only<br><br>50k (GFSK) @ 200 kHz Bandwidth -<br>Channel 3 only<br><br>100k (GFSK) @ 200 kHz Bandwidth -<br>Channel 3 only<br>Low range, fast |
| Channel        | Radio channel (Frequency) | 00: 869.40 MHz Not allowed<br>01: 869.45 MHz<br>02: 869.50 MHz<br>03: 869.55 MHz<br>04: 869.60 MHz                                                                                                                                                                                |
| HF Power Level | Transmitting power        | 12-25 dBm                                                                                                                                                                                                                                                                         |

**ATTENTION!**

Selectable settings are CE compliant according to EN 300 220 standard. Other combinations are not permitted!

**NOTE:** The higher the RF rate, the faster the transmission but the range is shorter

All devices in a radio system must be set to the same radio channel. DATAEAGLE radio systems in parallel operation are to be operated with different radio channels! However, it should be noted that at high RF rate only 1 system is possible due to the available bandwidth!


It makes sense to reduce the transmitting power in order not to influence neighboring radio systems in the same frequency band!

### 6.3.4 915 MHz - DATAEAGLE Compact/Xtreme 334x

#### NOTE

If a radio system was ordered as a set (set configuration), no change is necessary here.

Select in the menu tree: *Interface* → *Radio* → *900 MHz*

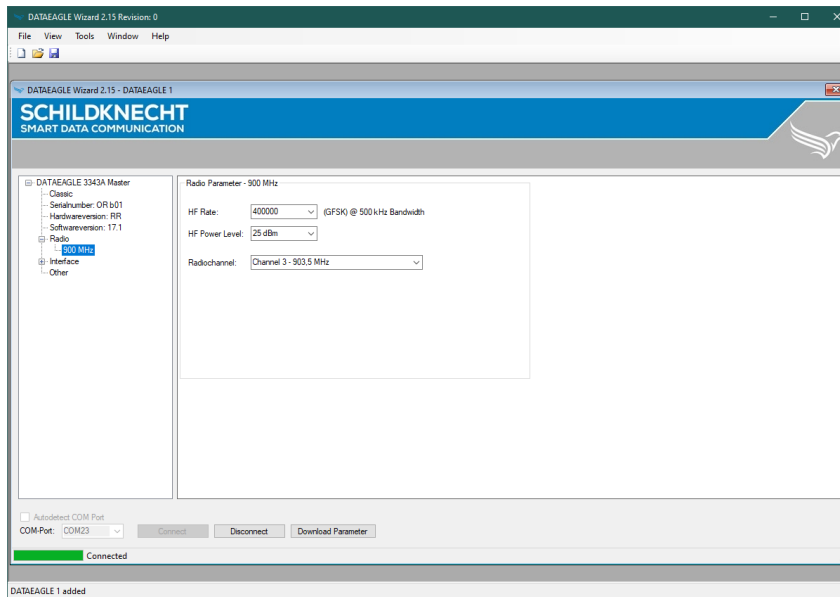

**Configuration parameters 915 MHz**

| Value          | Description        | Comment                                                                                                                                                                         |
|----------------|--------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| HF Rate        | Modulation method  | 30k (LR DSSS FEC) @ 500kHz<br>Bandwidth - Channel 1-51<br><br>240k (LR DSSS FEC) @ 500 kHz<br>Bandwidth - Channel 1-51<br><br>400k (GFSK) @ 500 kHz<br>Bandwidth - Channel 1-51 |
| Channel        | Radio channel      | 01: 902.5 MHz<br>02: 903 MHz<br>..... 500 kHz / Channel<br>51: 927,5 MHz                                                                                                        |
| HF Power Level | Transmitting power | 12-25 dBm                                                                                                                                                                       |

**ATTENTION!**

Selectable settings are FCC Part 15 compliant. Other combinations are not permitted!

**NOTE:** The higher the RF rate, the faster the transmission but the range is shorter

All devices in a radio system must be set to the same radio channel.  
DATAEAGLE radio systems in parallel operation are to be operated with different radio channels!  
It makes sense to reduce the transmitting power in order not to influence neighboring radio systems in the same frequency band!



## 6.4 Diagnosis

2 variants of device diagnostics are available:

- Diagnostics via integrated PROFIBUS slave
- Diagnosis via the configuration tool DATAEAGLE Wizard


### 6.4.1 Integrated PROFIBUS DP diagnostic slave

The diagnostic slave is a PROFIBUS station for monitoring the radio link and the connected PROFIBUS stations.


To access the data of the diagnostic slave, a PROFIBUS address must be configured on the DATAEAGLE master for the diagnostic slave. A PROFIBUS master can then access and read out this data.

To do this, connect DATAEAGLE to the PC via the USB cable and start the DATAEAGLE Wizard configuration software.

Select *Autodetect COM Port* and then *Connect* to connect to DATAEAGLE and read the configuration. The DATAEAGLE must be switched on for this.

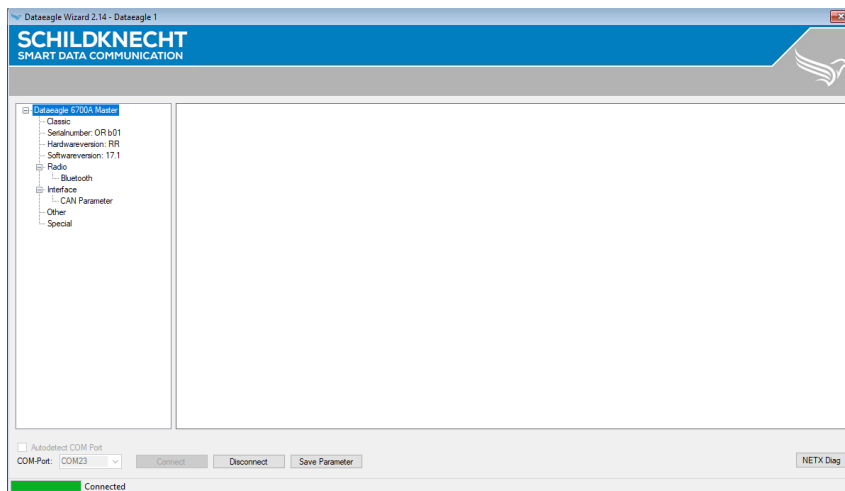

Select in the menu tree: *Interface* → *DP Parameter*

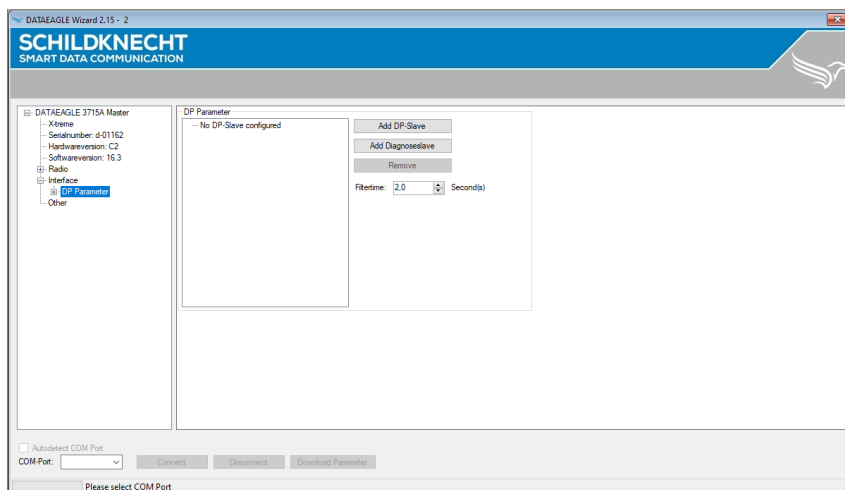

Configure via *Add Diagnoseslave* the PROFIBUS address for the Diagnoseslave and the PROFIBUS Master address, which should read out the Diagnoseslave.

The GSD file for integration into the hardware configuration is available for download on our website.

The diagnostic data is divided into several data blocks. Each data block is 32 bytes in size.



Data structure of the send data to the diagnostic slave:

| Byte  | Function                                                                 | Value                                         |
|-------|--------------------------------------------------------------------------|-----------------------------------------------|
| 0     | Block selection 0-7 resp. 255                                            | 0..255                                        |
| 1     | Block 0: Reset counters<br><br>Other: Parameters, depending on the block | 0: No function<br>1: Reset counters<br>0..255 |
| 2..30 | Parameters, depending on the block                                       | 0..255                                        |
| 31    | reserved                                                                 | 0                                             |



Data structure of the received data from the diagnostic slave:

Block 0: General diagnostic values

| Byte   | Function                             | Value                                                                                                         |
|--------|--------------------------------------|---------------------------------------------------------------------------------------------------------------|
| 0      | Baudrate                             | 1 : 1.5 MBit/s<br>2 : 500 KBit/s<br>3 : 187.5 KBit/s<br>4 : 93.75 KBit/s<br>5 : 19.2 KBit/s<br>6 : 9.6 KBit/s |
| 1      | Filter setting [*100ms]              | 1..255 (100ms..25.5s)                                                                                         |
| 2      | Power-Up counter                     | Power-on procedures of the DATAEAGLE Master                                                                   |
| 3      | PROFIBUS errors                      |                                                                                                               |
| 4/5    | Total retries of the radio interface | Radio telegrams which had to be repeated                                                                      |
| 6/7    | Total slave failures                 | Radio interrupts with PROFIBUS bus error                                                                      |
| 8/9    | Total slave response telegrams       |                                                                                                               |
| 10..13 | DATAEAGLE device type                | ASCII coded                                                                                                   |
| 14..17 | DATAEAGLE Software Version           | ASCII coded                                                                                                   |
| 18..21 | PROFIBUS Interface Software Version  | ASCII coded                                                                                                   |
| 22     | Radio channel                        | (type-dependent)                                                                                              |
| 23     | HF Retries                           | (type-dependent)                                                                                              |
| 24     | HF Power                             | Transmitting power (type-dependent)                                                                           |
| 25     | Radio device address                 |                                                                                                               |
| 26     | Radio partner address                |                                                                                                               |
| 27     | Master/Slave                         |                                                                                                               |
| 28     | Relay Timeout                        | (type-dependent)                                                                                              |
| 29/30  |                                      |                                                                                                               |
| 31     | 0                                    | Block number 0                                                                                                |



## Block 1: PROFIBUS Slave addresses

| Byte | Function           | Value                            |
|------|--------------------|----------------------------------|
| 0    | PROFIBUS Address 1 | 1..125<br>127: no PROFIBUS Slave |
| 1    | PROFIBUS Address 2 | 1..125<br>127: no PROFIBUS Slave |
| ..   |                    |                                  |
| 31   | 1                  | Block number 1                   |

## Block 2: PROFIBUS status of slave

| Byte | Function       | Value                    |
|------|----------------|--------------------------|
| 0    | Status Slave 1 | 0..10<br>5: DataExchange |
| 1    | Status Slave 2 | 0..10<br>5: DataExchange |
| ..   |                |                          |
| 31   | 2              | Block number 2           |

## Block 3: Slave response time (DataExchange time)

| Byte | Function              | Value          |
|------|-----------------------|----------------|
| 0    | Response time Slave 1 | 0..255 [*10ms] |
| 1    | Response time Slave 2 | 0..255 [*10ms] |
| ..   |                       |                |
| 31   | 3                     | Block number 3 |

## Block 4: Radio retries per PROFIBUS slave

| Byte | Function        | Value          |
|------|-----------------|----------------|
| 0    | Retries Slave 1 | 0..255         |
| 1    | Retries Slave 2 | 0..255         |
| ..   |                 |                |
| 31   | 4               | Block number 4 |



## Block 5: Restarts (radio)

| Byte | Function         | Value          |
|------|------------------|----------------|
| 0    | Restarts Slave 1 | 0..255         |
| 1    | Restarts Slave 2 | 0..255         |
| ..   |                  |                |
| 31   | 5                | Block number 5 |

## Block 6: Restarts (PROFIBUS)

| Byte | Function         | Value          |
|------|------------------|----------------|
| 0    | Restarts Slave 1 | 0..255         |
| 1    | Restarts Slave 2 | 0..255         |
| ..   |                  |                |
| 31   | 6                | Block number 6 |

## Block 7: Average data rate (telegrams/second)

| Byte | Function          | Value              |
|------|-------------------|--------------------|
| 0    | Data rate Slave 1 | 0..255 tel./second |
| 1    | Data rate Slave 2 | 0..255 tel./second |
| ..   |                   |                    |
| 31   | 7                 | Block number 7     |

## Block 8: Control of the radio slaves

Data structure of the send data to the diagnostics slave:

| Byte | Function              | Value                                                 |
|------|-----------------------|-------------------------------------------------------|
| 0    | Block number          | 8                                                     |
| 1    | Slave radio address 1 | 0: activated<br>1: Automatic mode<br>255: deactivated |
| 2    | Slave radio address 2 | 0: activated<br>1: Automatic mode<br>255: deactivated |
| ..   |                       |                                                       |
| 31   | Block number          | 8                                                     |

Data structure of the receive data from the diagnostics slave:

| Byte | Function              | Value                       |
|------|-----------------------|-----------------------------|
| 0    | Dummy                 |                             |
| 1    | Slave radio address 1 | 0..9<br>127: no radio slave |
| 2    | Slave radio address 2 | 0..9<br>127: no radio slave |
| ..   |                       |                             |
| 31   | Block number          | 8                           |

The DATAEAGLE master cyclically tries to address all radio slaves. In some applications, system parts are deliberately de-energized and are therefore no longer accessible by radio. To avoid unnecessary timeouts, the radio nodes can be logged out via block 8.

In automatic mode, this task is performed by DATAEAGLE itself. It should be noted, however, that automatic recognition requires a certain amount of time. During this time, timeouts may occur. Every 25 seconds, the DATAEAGLE master attempts to determine whether the slave can be reached again. Then a timeout also occurs.



## Block 9: Radio retries per radio slave

| Byte | Function              | Value          |
|------|-----------------------|----------------|
| 0    | Radio retries Slave 1 | 0..255         |
| 1    | Radio retries Slave 2 | 0..255         |
| ..   |                       |                |
| 31   | 9                     | Block number 9 |

## Block 10: Max. Timeout time per radio slave

| Byte | Function             | Value           |
|------|----------------------|-----------------|
| 0    | Max. Timeout Slave 1 | 0..255 Sec.     |
| 1    | Max. Timeout Slave 2 | 0..255 Sec.     |
| ..   |                      |                 |
| 31   | 10                   | Block number 10 |

## Block 255: Reset all counters

| Byte | Function | Value            |
|------|----------|------------------|
| 0    | Dummy    |                  |
| 1    | Dummy    |                  |
| ..   |          |                  |
| 31   | 255      | Block number 255 |


**NOTE**

If the block numbers are read cyclically from the PLC, byte 31 must be queried to ensure that the correct page is returned by DATAEAGLE. It may take some PLC cycles until the requested block number is returned.

### 6.4.2 Diagnostic via terminal mode

A PROFIBUS diagnosis is possible via the terminal function of the DATAEAGLE Wizard. The following steps are necessary for this.

In the DATAEAGLE Wizard, use the "Tools" menu to select "Terminalmode". A new window opens. Check the COM port and select "Connect".

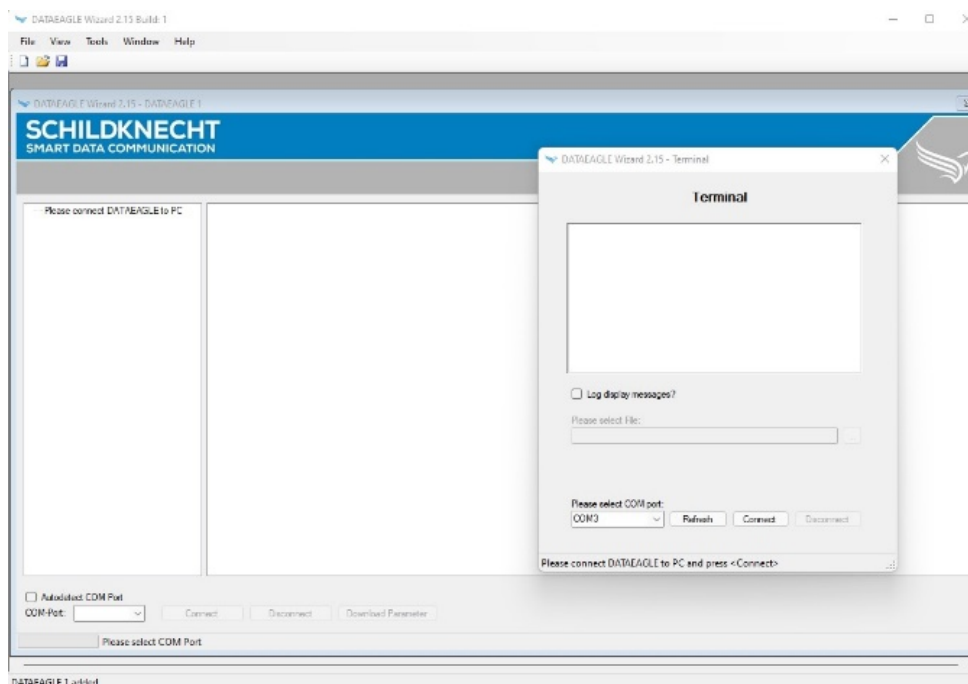

The document ([DATAEAGLE 3000 Series - Diagnostic via DATAEAGLE Wizard.pdf](#)) describes and explains the display in the terminal.

## 7 Tips and tricks

### 7.1 Improvement of EMC resistance

#### 7.1.1 Introduction

##### Industrial use

The device is manufactured and developed according to the latest state of the art. Both the robust mechanical construction and the design of the electronic components are designed for industrial use.

To ensure trouble-free operation, rules must be observed when installing the devices in systems. If these are not observed, the high interference and destruction resistance of the devices will be partially ineffective.

The immunity of the entire system depends largely on correct installation, location and wiring.

- Check the controller manufacturer's assembly instructions for safe operation.
- Bring these into line with the recommendations for EMC-compliant design.
- Then install the device

#### 7.1.2 Basic rules

##### PE connection (protective earth)

Interference voltages coupled into the device via the supply and signal lines, as well as electrostatic voltages transmitted by touch, are discharged to the grounding point.

→ Connect the grounding point to the **PE-connector** of the device with low impedance using the shortest possible copper conductor.

##### Shielding

Shielded lines reduce the **probability of interference**:

- by a factor of 100 compared to unshielded cables
- by a factor of 1000 if looping is also avoided.

The density of the braided shield should be at least 85%. To prevent the interference currents coupled onto the cable shield from becoming interference sources themselves, a low-impedance connection to the grounding point is particularly important.

→ **Always** use shielded cables for interfaces and power supplies.

→ Use shielding braid with a density of at least 85 %.

→ **Always** connect the shield on both sides to the EMC ground (usually PE).

##### Bus and power lines



→ Lay bus lines at least 20 cm away from power lines in separate cable ducts.

#### **Unused wires**

→ Always connect all unused wires of a line to PE on both sides.

#### **Connector housing**

→ Take metallic or metallized connector housings

→ Always place the shield of the cable on the connector housing.

#### **Mounting plate**

The mounting plate forms the EMC ground (star point) and is largely responsible for interference suppression.

→ Always mount all electronic devices on a galvanized mounting plate in the control cabinet. This allows the interference energy to flow directly back to the source of interference.

→ Do not use coated surfaces, such as yellow chromated anodizing.

---

#### **NOTICE:**

Sufficient dissipation of the RF fields via the PE network is not possible due to the high line impedance. Therefore, the PE network is not the same as the EMC ground, although they are directly connected electrically.

---

#### **EMC ground**

→ Make all connections with the EMC ground as short and large as possible.

---

#### **NOTICE::**

Make sure that all metallic housings have good contact with the galvanized mounting surface.

---

#### **Sources of interference for RF fields**

##### **ATTENTION**

#### **Danger from sources of interference for HF fields**

Electronic or electrical components without a closed metal housing are a source of interference for RF fields.

→ Make sure that all electronic or electrical components that could be a source of interference from RF fields have a closed metal housing.



## Protective conductor

### ATTENTION

#### Unfavorable protective conductor connections and conductor loops

EMC measures can be bypassed and rendered ineffective by unfavorable PE conductor connections and conductor loops. PE conductor loops can act like antennas and couple interference.

→ Route protective conductors of the individual system components in a star configuration to the equipotential bonding rail.

## 7.2 Optimal antenna mounting

Instructions for antenna mounting and alignment can be found in our Antenna 1x1 → <https://www.schildknecht.ag/download/antennen-1mal1/>



## 8 Technical data

### **WARNING!**

**Danger to life due to electric shock.**

**Operation of the device only intended on 24 V DC (safety extra-low voltage).**

Death and serious injuries as well as considerable property damage can be the result.

- The device may only be connected by an electrician in accordance with IEC 60364!
- No direct connection of these devices to other networks!
- Observe five safety rules! See chapter 2.1

## 8.1 DATAEAGLE Compact 3715A Master/Slave - Article number: 11160 / 11161

### General

|                         |              |
|-------------------------|--------------|
| Power supply            | 24 V DC      |
| Power supply connection | terminals    |
| Power consumption       | 100mA        |
| Protection class        | IP20         |
| Temperature range       | -20...+60 °C |
| Conformity              | CE, FCC, IC  |
| Weight                  | 130g         |
| Wide                    | 22,5 mm      |
| Height                  | 99 mm        |
| Depth                   | 114,5 mm     |
| Color                   | Black        |

### Radio technology

|                             |                                 |
|-----------------------------|---------------------------------|
| Frequency                   | 2,4 GHz Bluetooth               |
| Transmitting power          | 100mW (EIRP)                    |
| Indoor range                | 100m                            |
| Outdoor range               | 300m                            |
| Max. Number of radio slaves | 1                               |
| Antenna connection          | SMA Anschluss (female) - 50 Ohm |

### Interface

|                                 |              |
|---------------------------------|--------------|
| Max. PROFIBUS transmission rate | 1.5 MBit/s   |
| PROFIBUS connection             | 9 pol. SUB-D |
| Max. PROFIBUS DP Slaves         | 4            |
| PROFIsafe                       | No           |

## 8.2 DATAEAGLE X-treme 3715A Master/Slave - Article number: 11320 / 11321

### General

|                         |                            |
|-------------------------|----------------------------|
| Power supply            | 24 V DC                    |
| Power supply connection | M12, A-coded, 5 pin (male) |
| Power consumption       | 100mA                      |
| Mounting                | 4-hole screw mounting      |
| Protection class        | IP65                       |
| Temperature range       | -20...+60 °C               |
| Conformity              | CE, FCC, IC                |
| Weight                  | 280g                       |
| Wide                    | 88 mm                      |
| Height                  | 120 mm                     |
| Depth                   | 42 mm                      |
| Color                   | Black                      |

### Radio technology

|                             |                                 |
|-----------------------------|---------------------------------|
| Frequency                   | 2,4 GHz Bluetooth               |
| Transmitting power          | 100mW (EIRP)                    |
| Indoor range                | 100m                            |
| Outdoor range               | 300m                            |
| Max. Number of radio slaves | 1                               |
| Antenna connection          | SMA Anschluss (female) - 50 Ohm |

### Interface

|                                 |                                            |
|---------------------------------|--------------------------------------------|
| Max. PROFIBUS transmission rate | 1.5 MBit/s                                 |
| PROFIBUS connection             | M12, B-coded, 5 pin (male), 5 pin (female) |
| Max. PROFIBUS DP Slaves         | 4                                          |
| PROFIsafe                       | No                                         |

### 8.3 DATAEAGLE Compact 3713A Master/Slave - Article number: 11164 / 11165

#### General

|                         |              |
|-------------------------|--------------|
| Power supply            | 24 V DC      |
| Power supply connection | terminals    |
| Power consumption       | 100mA        |
| Protection class        | IP20         |
| Temperature range       | -20...+60 °C |
| Conformity              | CE, FCC, IC  |
| Weight                  | 130g         |
| Wide                    | 22,5 mm      |
| Height                  | 99 mm        |
| Depth                   | 114,5 mm     |
| Color                   | Black        |

#### Radio technology

|                             |                                 |
|-----------------------------|---------------------------------|
| Frequency                   | 2,4 GHz Bluetooth               |
| Transmitting power          | 100mW (EIRP)                    |
| Indoor range                | 100m                            |
| Outdoor range               | 300m                            |
| Max. Number of radio slaves | 4                               |
| Antenna connection          | SMA Anschluss (female) - 50 Ohm |

#### Interface

|                                 |              |
|---------------------------------|--------------|
| Max. PROFIBUS transmission rate | 1.5 MBit/s   |
| PROFIBUS connection             | 9 pol. SUB-D |
| Max. PROFIBUS DP Slaves         | 4            |
| PROFIsafe                       | No           |

## 8.4 DATAEAGLE X-treme 3713A Master/Slave - Article number: 11324 / 11325

### General

|                         |                            |
|-------------------------|----------------------------|
| Power supply            | 24 V DC                    |
| Power supply connection | M12, A-coded, 5 pin (male) |
| Power consumption       | 100mA                      |
| Mounting                | 4-hole screw mounting      |
| Protection class        | IP65                       |
| Temperature range       | -20...+60 °C               |
| Conformity              | CE, FCC, IC                |
| Weight                  | 280g                       |
| Wide                    | 88 mm                      |
| Height                  | 120 mm                     |
| Depth                   | 42 mm                      |
| Color                   | Black                      |

### Radio technology

|                             |                                 |
|-----------------------------|---------------------------------|
| Frequency                   | 2,4 GHz Bluetooth               |
| Transmitting power          | 100mW (EIRP)                    |
| Indoor range                | 100m                            |
| Outdoor range               | 300m                            |
| Max. Number of radio slaves | 4                               |
| Antenna connection          | SMA Anschluss (female) - 50 Ohm |

### Interface

|                                 |                                            |
|---------------------------------|--------------------------------------------|
| Max. PROFIBUS transmission rate | 1.5 MBit/s                                 |
| PROFIBUS connection             | M12, B-coded, 5 pin (male), 5 pin (female) |
| Max. PROFIBUS DP Slaves         | 4                                          |
| PROFIsafe                       | No                                         |

## 8.5 DATAEAGLE Compact 3712A Master/Slave - Article number: 11168 / 11169

### General

|                         |              |
|-------------------------|--------------|
| Power supply            | 24 V DC      |
| Power supply connection | terminals    |
| Power consumption       | 100mA        |
| Protection class        | IP20         |
| Temperature range       | -20...+60 °C |
| Conformity              | CE, FCC, IC  |
| Weight                  | 130g         |
| Wide                    | 22,5 mm      |
| Height                  | 99 mm        |
| Depth                   | 114,5 mm     |
| Color                   | Black        |

### Radio technology

|                             |                                 |
|-----------------------------|---------------------------------|
| Frequency                   | 2,4 GHz Bluetooth               |
| Transmitting power          | 100mW (EIRP)                    |
| Indoor range                | 100m                            |
| Outdoor range               | 300m                            |
| Max. Number of radio slaves | 4                               |
| Antenna connection          | SMA Anschluss (female) - 50 Ohm |

### Interface

|                                 |              |
|---------------------------------|--------------|
| Max. PROFIBUS transmission rate | 1.5 MBit/s   |
| PROFIBUS connection             | 9 pol. SUB-D |
| Max. PROFIBUS DP Slaves         | 8            |
| PROFIsafe                       | Yes          |

## 8.6 DATAEAGLE X-treme 3712A Master/Slave - Article number: 11326 / 11327

### General

|                         |                            |
|-------------------------|----------------------------|
| Power supply            | 24 V DC                    |
| Power supply connection | M12, A-coded, 5 pin (male) |
| Power consumption       | 100mA                      |
| Mounting                | 4-hole screw mounting      |
| Protection class        | IP65                       |
| Temperature range       | -20...+60 °C               |
| Conformity              | CE, FCC, IC                |
| Weight                  | 280g                       |
| Wide                    | 88 mm                      |
| Height                  | 120 mm                     |
| Depth                   | 42 mm                      |
| Color                   | Black                      |

### Radio technology

|                             |                                 |
|-----------------------------|---------------------------------|
| Frequency                   | 2,4 GHz Bluetooth               |
| Transmitting power          | 100mW (EIRP)                    |
| Indoor range                | 100m                            |
| Outdoor range               | 300m                            |
| Max. Number of radio slaves | 4                               |
| Antenna connection          | SMA Anschluss (female) - 50 Ohm |

### Interface

|                                 |                                            |
|---------------------------------|--------------------------------------------|
| Max. PROFIBUS transmission rate | 1.5 MBit/s                                 |
| PROFIBUS connection             | M12, B-coded, 5 pin (male), 5 pin (female) |
| Max. PROFIBUS DP Slaves         | 8                                          |
| PROFIsafe                       | Yes                                        |

## 8.7 DATAEAGLE Compact 3333A Master/Slave - Article number: 11142 / 11143

### General

|                         |              |
|-------------------------|--------------|
| Power supply            | 24 V DC      |
| Power supply connection | terminals    |
| Power consumption       | 100mA        |
| Protection class        | IP20         |
| Temperature range       | -20...+60 °C |
| Conformity              | CE           |
| Weight                  | 160g         |
| Wide                    | 22,5 mm      |
| Height                  | 99 mm        |
| Depth                   | 114,5 mm     |
| Color                   | Black        |

### Radio technology

|                             |                                 |
|-----------------------------|---------------------------------|
| Frequency                   | 869 MHz                         |
| Transmitting power          | 500mW (EIRP)                    |
| Indoor range                | 300m                            |
| Outdoor range               | 1-3 km                          |
| Max. Number of radio slaves | 4                               |
| Antenna connection          | SMA Anschluss (female) - 50 Ohm |

### Interface

|                                 |              |
|---------------------------------|--------------|
| Max. PROFIBUS transmission rate | 1.5 MBit/s   |
| PROFIBUS connection             | 9 pol. SUB-D |
| Max. PROFIBUS DP Slaves         | 4            |
| PROFIsafe                       | No           |



## 8.8 DATAEAGLE X-treme 3333A Master/Slave - Article number: 11370 / 11371

### General

|                         |                            |
|-------------------------|----------------------------|
| Power supply            | 24 V DC                    |
| Power supply connection | M12, A-coded, 5 pin (male) |
| Power consumption       | 100mA                      |
| Mounting                | 4-hole screw mounting      |
| Protection class        | IP65                       |
| Temperature range       | -20...+60 °C               |
| Conformity              | CE                         |
| Weight                  | 280g                       |
| Wide                    | 88 mm                      |
| Height                  | 120 mm                     |
| Depth                   | 42 mm                      |
| Color                   | Black                      |

### Radio technology

|                             |                                 |
|-----------------------------|---------------------------------|
| Frequency                   | 869 MHz                         |
| Transmitting power          | 500mW (EIRP)                    |
| Indoor range                | 300m                            |
| Outdoor range               | 1-3km                           |
| Max. Number of radio slaves | 4                               |
| Antenna connection          | SMA Anschluss (female) - 50 Ohm |

### Interface

|                                 |                                            |
|---------------------------------|--------------------------------------------|
| Max. PROFIBUS transmission rate | 1.5 MBit/s                                 |
| PROFIBUS connection             | M12, B-coded, 5 pin (male), 5 pin (female) |
| Max. PROFIBUS DP Slaves         | 4                                          |
| PROFIsafe                       | No                                         |

## 8.9 DATAEAGLE Compact 3343A Master/Slave - Article number: 11148 / 11149

### General

|                         |              |
|-------------------------|--------------|
| Power supply            | 24 V DC      |
| Power supply connection | terminals    |
| Power consumption       | 100mA        |
| Protection class        | IP20         |
| Temperature range       | -20...+60 °C |
| Conformity              | FCC          |
| Weight                  | 160g         |
| Wide                    | 22,5 mm      |
| Height                  | 99 mm        |
| Depth                   | 114,5 mm     |
| Color                   | Black        |

### Radio technology

|                             |                                 |
|-----------------------------|---------------------------------|
| Frequency                   | 915 MHz                         |
| Transmitting power          | 500mW (EIRP)                    |
| Indoor range                | 300m                            |
| Outdoor range               | 1-3 km                          |
| Max. Number of radio slaves | 4                               |
| Antenna connection          | SMA Anschluss (female) - 50 Ohm |

### Interface

|                                 |              |
|---------------------------------|--------------|
| Max. PROFIBUS transmission rate | 1.5 MBit/s   |
| PROFIBUS connection             | 9 pol. SUB-D |
| Max. PROFIBUS DP Slaves         | 4            |
| PROFIsafe                       | No           |

## 8.10 DATAEAGLE X-treme 3343A Master/Slave - Article number: 11330 / 11331

### General

|                         |                            |
|-------------------------|----------------------------|
| Power supply            | 24 V DC                    |
| Power supply connection | M12, A-coded, 5 pin (male) |
| Power consumption       | 100mA                      |
| Mounting                | 4-hole screw mounting      |
| Protection class        | IP65                       |
| Temperature range       | -20...+60 °C               |
| Conformity              | FCC                        |
| Weight                  | 280g                       |
| Wide                    | 88 mm                      |
| Height                  | 120 mm                     |
| Depth                   | 42 mm                      |
| Color                   | Black                      |

### Radio technology

|                             |                                 |
|-----------------------------|---------------------------------|
| Frequency                   | 915 MHz                         |
| Transmitting power          | 500mW (EIRP)                    |
| Indoor range                | 300m                            |
| Outdoor range               | 1-3km                           |
| Max. Number of radio slaves | 4                               |
| Antenna connection          | SMA Anschluss (female) - 50 Ohm |

### Interface

|                                 |                                            |
|---------------------------------|--------------------------------------------|
| Max. PROFIBUS transmission rate | 1.5 MBit/s                                 |
| PROFIBUS connection             | M12, B-coded, 5 pin (male), 5 pin (female) |
| Max. PROFIBUS DP Slaves         | 4                                          |
| PROFIsafe                       | No                                         |

## 8.11 DATAEAGLE Compact 373xA - Article number: 15375

### Master/Slave

|                      |                       |
|----------------------|-----------------------|
| Configuration Master | Article number: 15383 |
| Configuration Slave  | Article number: 15384 |

### General

|                         |              |
|-------------------------|--------------|
| Power supply            | 24 V DC      |
| Power supply connection | terminals    |
| Power consumption       | 100mA        |
| Protection class        | IP20         |
| Temperature range       | -20...+60 °C |
| Conformity              | CE, FCC, IC  |
| Weight                  | 130g         |
| Wide                    | 22,5 mm      |
| Height                  | 99 mm        |
| Depth                   | 114,5 mm     |
| Color                   | Black        |

### Radio technology

|                    |                                 |
|--------------------|---------------------------------|
| Frequency          | 2,4 GHz Bluetooth 5             |
| Transmitting power | 8dBm                            |
| Indoor range       | 100m                            |
| Outdoor range      | 300m                            |
| Antenna connection | SMA Anschluss (female) - 50 Ohm |

### Interface

|                                 |              |
|---------------------------------|--------------|
| Max. PROFIBUS transmission rate | 1.5 MBit/s   |
| PROFIBUS connection             | 9 pol. SUB-D |

**8.11.1 Software Feature PROFIBUS Point-to-Point - Article number: 15380**

|                             |    |
|-----------------------------|----|
| Max. Number of radio slaves | 1  |
| Max. PROFIBUS DP Slaves     | 4  |
| PROFIsafe                   | No |

**8.11.2 Software Feature PROFIBUS Multipoint - Article number: 15381**

|                             |    |
|-----------------------------|----|
| Max. Number of radio slaves | 4  |
| Max. PROFIBUS DP Slaves     | 4  |
| PROFIsafe                   | No |

**8.11.3 Software Feature PROFIBUS PROFIsafe Multipoint - Article number: 15382**

|                             |     |
|-----------------------------|-----|
| Max. Number of radio slaves | 4   |
| Max. PROFIBUS DP Slaves     | 8   |
| PROFIsafe                   | Yes |

## 8.12 DATAEAGLE X-treme 373xA - Article number: 15376

### Master/Slave

|                      |                       |
|----------------------|-----------------------|
| Configuration Master | Article number: 15383 |
| Configuration Slave  | Article number: 15384 |

### General

|                         |                            |
|-------------------------|----------------------------|
| Power supply            | 24 V DC                    |
| Power supply connection | M12, A-coded, 5 pin (male) |
| Power consumption       | 100mA                      |
| Mounting                | 4-hole screw mounting      |
| Protection class        | IP65                       |
| Temperature range       | -20...+60 °C               |
| Conformity              | CE, FCC, IC                |
| Weight                  | 280g                       |
| Wide                    | 88 mm                      |
| Height                  | 120 mm                     |
| Depth                   | 42 mm                      |
| Color                   | Black                      |

### Radio technology

|                    |                                 |
|--------------------|---------------------------------|
| Frequency          | 2,4 GHz Bluetooth 5             |
| Transmitting power | 8dBm                            |
| Indoor range       | 100m                            |
| Outdoor range      | 300m                            |
| Antenna connection | SMA Anschluss (female) - 50 Ohm |

### Interface

|                                 |                                            |
|---------------------------------|--------------------------------------------|
| Max. PROFIBUS transmission rate | 1.5 MBit/s                                 |
| PROFIBUS connection             | M12, B-coded, 5 pin (male), 5 pin (female) |

**8.12.1 Software Feature PROFIBUS Point-to-Point - Article number: 15380**

|                             |    |
|-----------------------------|----|
| Max. Number of radio slaves | 1  |
| Max. PROFIBUS DP Slaves     | 4  |
| PROFIsafe                   | No |

**8.12.2 Software Feature PROFIBUS Multipoint - Article number: 15381**

|                             |    |
|-----------------------------|----|
| Max. Number of radio slaves | 4  |
| Max. PROFIBUS DP Slaves     | 4  |
| PROFIsafe                   | No |

**8.12.3 Software Feature PROFIBUS PROFIsafe Multipoint - Article number: 15382**

|                             |     |
|-----------------------------|-----|
| Max. Number of radio slaves | 4   |
| Max. PROFIBUS DP Slaves     | 8   |
| PROFIsafe                   | Yes |

## 9 Legal notice

### Disclaimer

Schildknecht AG has checked the contents of this technical documentation for conformity with the hardware or software described. Deviations cannot be excluded in individual cases, which is why we exclude the warranty for the correctness of the content and the liability for errors, in particular for complete conformity. The limitation of liability does not apply insofar as the cause of the damage is due to intent and/or gross negligence, as well as for all claims arising from the Product Liability Act. Insofar as an essential contractual obligation has been breached through slight negligence, the liability of Schildknecht AG shall be limited to the damage typically arising.

We reserve the right to make technical and content-related changes. We recommend that you check at regular intervals whether this documentation has been updated, as corrections that may become necessary, for example, due to technical developments, are regularly incorporated by Schildknecht AG. We are always grateful for suggestions for improvement.

### Copyright

The transfer and reproduction of the documentation on paper or in digital form, the exploitation and communication of its content is not permitted unless this has been expressly granted by Schildknecht AG or is done in connection with the creation of own documentation of products which themselves contain products of Schildknecht AG. Infringements oblige to compensation. All rights are reserved, in particular in the event of patent grant or CTM registration.

### Rights of use

Schildknecht AG grants its customers a non-exclusive right to this technical documentation, revocable at any time and for an unlimited period of time, to use it to create their own technical documentation. For this purpose, Schildknecht AG's documentation may be modified or supplemented in excerpts as well as reproduced and provided to the customer's customers as part of the customer's own technical documentation on paper or data carriers. In doing so, however, the customer shall assume sole responsibility for the correctness of the contents of the technical documentation prepared by it.

If the technical documentation is incorporated in whole or in part into the customer's technical documentation, the customer must refer to the authorship of Schildknecht AG. It is also essential to ensure that the safety-related notes are retained.

Although the customer is obliged to indicate the authorship of Schildknecht AG, as far as the technical documentations of Schildknecht AG are used, the customer distributes or uses the technical documentations in sole responsibility. The reason for this is that we have no influence on the changes or uses of the technical documentation and even minor changes to the initial product or deviations from the intended uses can render the specifications recorded in the technical documentation incorrect. For this reason, the customer is also obliged



to mark the technical documentation originating from Schildknecht AG if and to the extent that the documentation has been modified by the customer. The customer undertakes to indemnify Schildknecht AG against claims for damages by third parties insofar as these are attributable to any existing defects in the documentation. This shall not apply to damage to the rights of third parties caused intentionally or by gross negligence.

The customer is entitled to use the company trademarks of Schildknecht AG exclusively in the context of its product advertising and only to the extent that products of Schildknecht AG have been integrated into the advertised products of the customer. The customer shall, when using trademarks of Schildknecht AG, indicate in a suitable manner that these are trademarks of Schildknecht AG.

